


FIG. 1

[illegible]

500 X



500 X

Sample: TEST vs. CONTROL
Type: Unsupported Nylon
Submitted: 3/23/01
Mode: SEM Cryosection

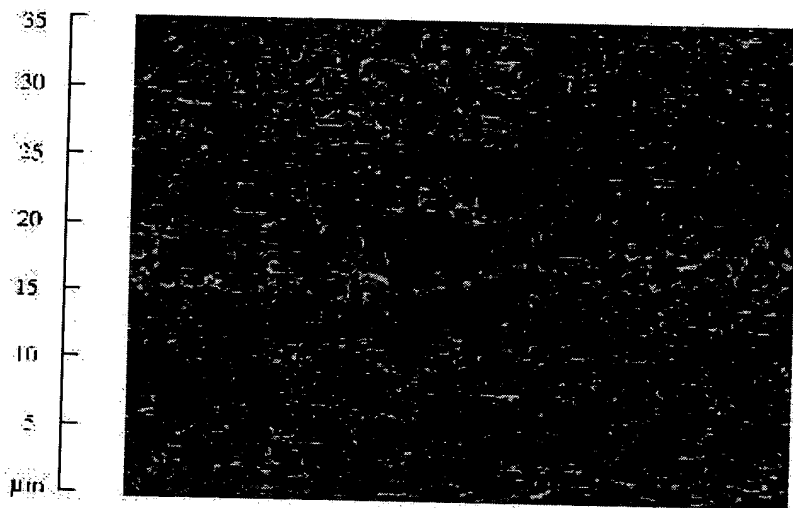


FIGURE 3a.

Sample: TEST

2,500 X

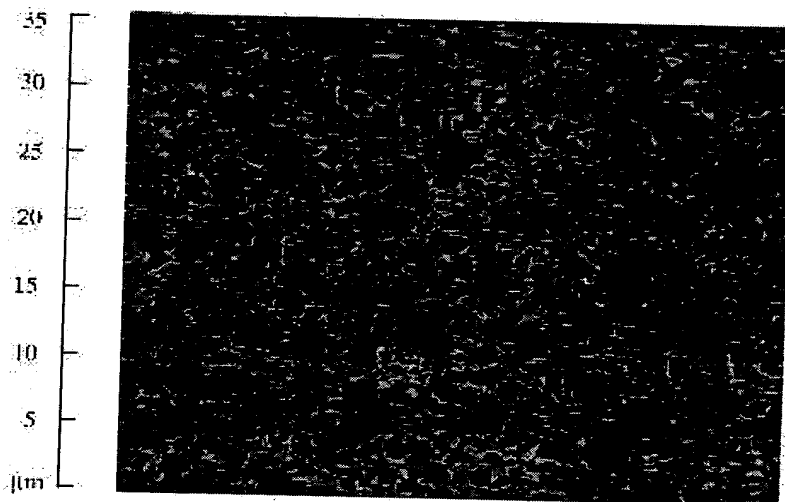


FIGURE 3b

Sample: CONTROL

2,500 X

Samples: TEST vs. CONTROL
Type: Unsupported Nylon
Submitted: 3/23/01
Mode: SEM Cryosection

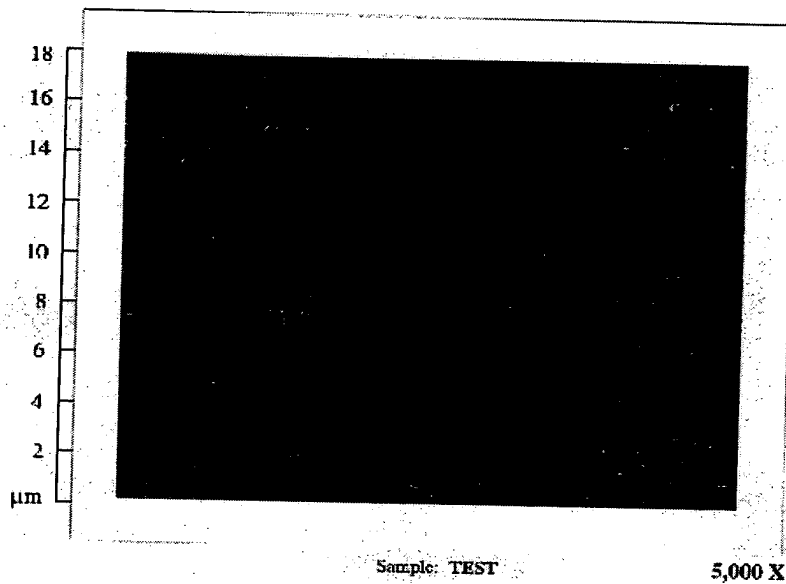


FIGURE 4a

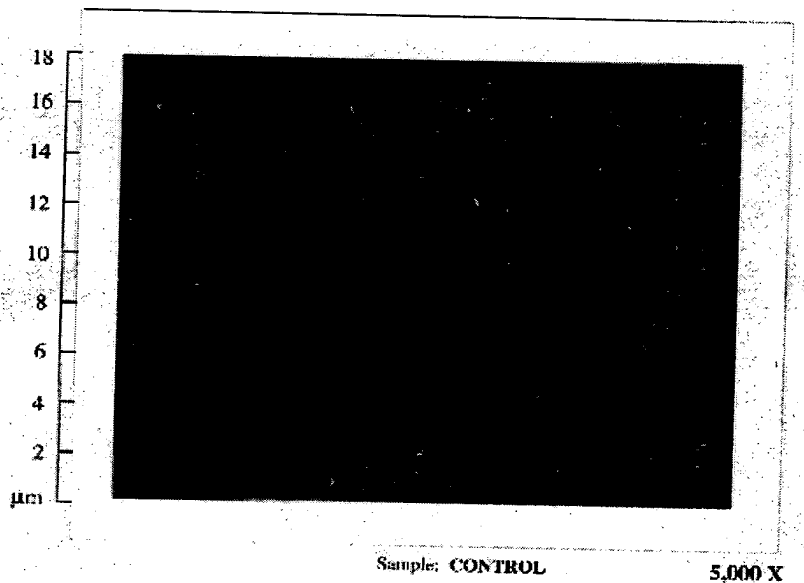







FIGURE 4b

U.S. GOVERNMENT PRINTING OFFICE: 2001-345-000

M	PCR controls	K562 DNA w/standard membrane	No template controls
			

M

K562 DNA w/ Xtra Bind
nylon membrane

[illegible]